



OEM SAFphire
Model OEM-DDCS-E

Programmable Linear Controller

For use with ABB Drives

Hardware Guide

Manual Version 1.01

FOR YOUR SAFETY

Only qualified personnel should install this equipment, after first reading and understanding all the information in this manual. All instructions should be strictly adhered to. The user should consult SAF DRIVES INC. or a SAF DRIVES INC. supplier for clarification of the contents of this manual should any doubt or questions arise.

The installation of this equipment must be conducted in accordance with all national, regional and local electrical codes.

All drawings and technical representations included in this manual are for typical installations and should not in any way be considered for specific applications or modifications. Consult SAF DRIVES INC. for supplemental instructions.

SAF DRIVES INC. accepts no liability for any consequences resulting from inappropriate, negligent or incorrect installation, application or adjustment of this equipment.

The contents of this manual are believed to be correct at the time of printing. In following with our commitment to the ongoing development and improvement of our products SAF DRIVES INC. reserves the right to change the specification of this product and/or the content of this instruction manual without notice.


Table of Contents

TABLE OF CONTENTS	5
OEM SAFPHIRE OVERVIEW	6
MODEL OEM-DDCS-E HARDWARE	7
Encoder Inputs	7
DDCS Fiber Optic Channels	7
Download Port.....	8
Handterm Port	8
Ethernet Port	8
Fault Relay	9
24 Volt Input.....	9
LEDs	9
Switches	10
Jumpers	10
TYPICAL CONFIGURATIONS	11
SBL BLOCKS	11
DIMENSION AND MOUNTING	12
HANDTERM OPERATION GUIDE	12
Introduction	12
Display Overview	13
Operating Modes.....	14
TECHNICAL SUPPORT	15
Contact Us	15

OEM SAFphire Overview

OEM SAFphire provides a leading edge drive control solution at an off-the-shelf price. It is a full featured, multiple drive, digital controller in a fixed I/O configuration, based on Brock Solution's SAFphire technology. Each version of OEM SAFphire combines the identical processing core of SAFphire with inputs, outputs and communication capabilities designed for specific applications. The same programming software and function blocks are available for OEM SAFphire that exists for SAFphire. The model OEM-DDCS-E version includes 3 encoder input channels, 2 serial ports for communicating to PLC's or MMI's, 3 DDCS fiber optic channels for communications to ABB ACS600, ACS800, DCS500 or SAF Drives Inc.' DD312 drives and an Ethernet port. All of the hardware inputs and outputs found on the drives can be accessed over the fiber optic DDCS link, eliminating the need and cost of local inputs and outputs on the controller itself.

OEM SAFphire combines exceptional performance and flexibility into a small form factor, DIN rail mount package.

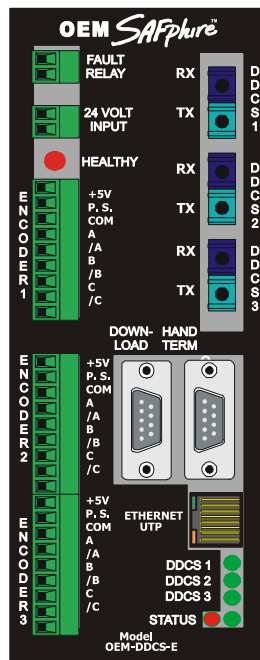


Model OEM-DDCS-E Hardware

The hardware of the model OEM-DDCS-E OEM SAFphire is designed to control small to medium sized drive systems using ABB ACS600, ACS800 AC Drives or DCS500, and DD312 DC Drives.

Encoder Inputs

3 pulse encoder inputs are provided. All 3 inputs can accept differential, quadrature input signals. To power the encoders from the internal 5 volt supply, connect the +5V terminal to the terminal labelled P.S. To use an external power supply of a different voltage, connect it between common (COM) and P.S.

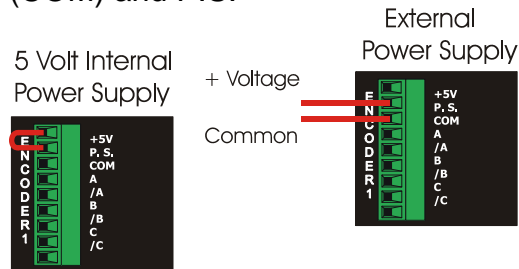

Encoder Input Specifications	
Max Input Frequency	300 kHz
Max External Power Supply	24 Volts
Max Encoder Current Draw (per channel)	150 mA

DDCS Fiber Optic Channels

3 DDCS Fiber Optic Communication channels are provided for communications with ABB ACS600, ACS800, DCS500 or DD312 Drives. For more information see SAFphire to ABB Drives Communications Using DDCS. The DDCS channels can also be used for communications between OEM SAFphires or between OEM SAFphires and SAFphire. For more information see SAFphire to SAFphire Communications Using DDCS.

	DDCS Specifications	
	Plastic Tx,Rx	HCS Tx,Rx
Baud Rate	4 Mbaud	4 Mbaud
Max Cable Length	10 meters using Plastic Cable	100 meters using HCS Cable
Max Data Sets per Node	3 pairs	3 pairs
Max Nodes per Channel	8	8

Download Port

The Download Port is a RS232 port with two functions. It can be used for Downloading / Annunciating programs from a PC with SBL or it can be used for Modbus or DF1 communications to a PLC or other compatible device. This port does not require or use any handshaking signals (RTS, CTS)

DB9 Male Pin	Function
2	Receive Data
3	Transmit Data
5	Common

This port is software configurable using SAF Manager software.

Handterm Port

The HandTerm Port is a RS232 port with two functions. It can be used for HandTerm Operations or it can be used for Modbus or DF1 communications to a PLC or other compatible device. This port does not require or use any handshaking signals (RTS, CTS). The HandHeld receives power from terminal 9 of this port.

DB9 Male Pin	Function
2	Receive Data
3	Transmit Data
9	+5V for HandHeld
5	Common

This port is software configurable using SAF Manager software.

Ethernet Port

The Ethernet port has a communication rate of 10Mbaud. It is used to upload, download and annunciate the application programs. The Ethernet port can also be used for OEM to OEM communications, OEM to SAFphire communications as well as interfacing to other equipment such as HMI's, PLC's, and various remote I/O modules.

Fault Relay

The Fault Relay provides a set of dry contacts that are normally wired into the ESTOP circuitry. These contacts will be closed whenever the OEM SAFphire is properly executing a Block Program. These contacts will open when downloading a new program, or if the Block Program is not executing (hardware failure, invalid program etc)

Fault Relay Specifications	
Current Rating	0.6 A resistive
Voltage Rating	120 VAC

24 Volt Input

OEM SAFphire will accept 24 V AC or DC as input power. When using a DC power source, polarity does not matter.

24 Volt Input Specifications	
Input Voltage	24 Volts AC or DC (+10%, -5%)
Input Power	20 VA

LEDs

LEDs are provided to indicate the status of OEM SAFphire.

STATUS: This green LED will flash once per second for normal operation. Other patterns indicate the following:

STATUS LED Patterns	
OFF solid	Hardware Failure
ON solid	Executing out of BootBlock Memory, due to 386 Code Checksum Error or SWITCH SETTINGS
1 Flash then OFF	386 Memory Test Error
2 Flash then OFF	320 Memory Test Error
3 Flash then OFF	320 Code Checksum Error
4 Flash then OFF	Block Program Checksum Error
5 Flash then OFF	Invalid Hardware Code
6 Flash then OFF	Flash Write Error (see Jumper Settings)
7 Flash then OFF	Misc. error code (see SAF Manager software manual)

RUNNING: This red LED will appear to be on (actually flashing once per scan time) whenever the program is executing.

DDCS1: The green LED will be on whenever DDCS channel 1 is transmitting.

DDCS2: The green LED will be on whenever DDCS channel 2 is transmitting.

DDCS3: The green LED will be on whenever DDCS channel 3 is transmitting.

HEALTHY: This red LED will be on whenever the FAULT RELAY contacts are closed.

Switches

There is 1 rotary switch found at the bottom of the OEM SAFphire. This switch controls the node address and 386 mode of the OEM SAFphire.

SW1 Settings	
0	Soft node setting (node is set by SAF Manager software)
1-7	OEM SAFphire Node Address.


Jumpers

There are a number of Jumpers inside the OEM SAFphire. These are not meant for user adjustment under normal circumstances.

Jumper	Function	Default
J1	When not installed, writes to Bootblock memory are disabled. If writes to BootBlock are attempted with this jumper not installed, the STATUS LED will indicate a FLASH WRITE ERROR.	not installed
J4	Installing this jumper will cause the OEM SAFphire to reset.	not installed

Typical Configurations

The following shows a typical usage of OEM SAFphire in a small to mid-size ABB Drive System.

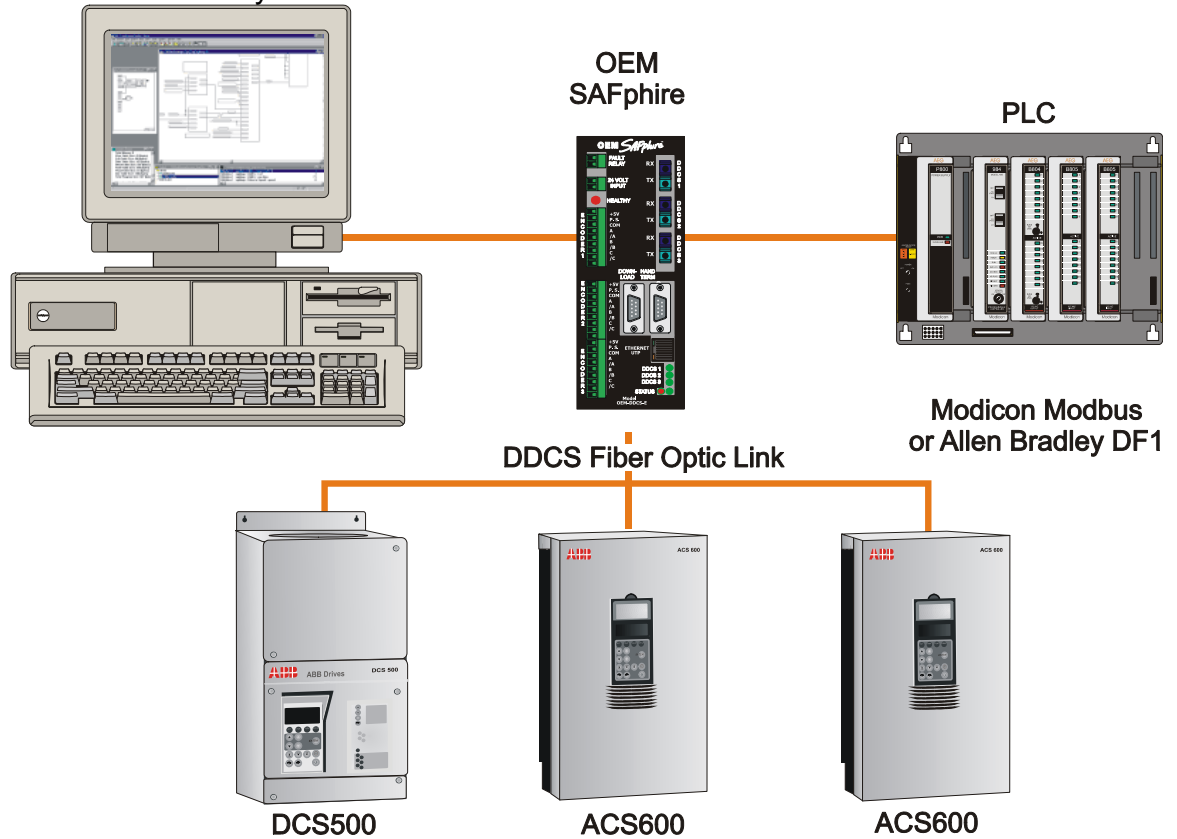

SBL Blocks


OEM SAFphire uses different input / output SBL blocks than SAFphire. The following blocks are the hardware dependant blocks for OEM SAFphire. Documentation for their usage can be found in the SBL Block Descriptions Manual

- DDCS INPUT
- DDCS OUTPUT
- COMM READ REG
- COMM WRITE REG
- COMM STATUS
- ENCODER INPUT

Dimension and Mounting

OEM SAFphire is DIN Rail Mount. Requiring panel space of 2.75 inches (73 mm) wide, 7 inches high (185 mm), and a panel depth of 8 inches (212 mm) (including RS232 connectors).

HandTerm Operation Guide

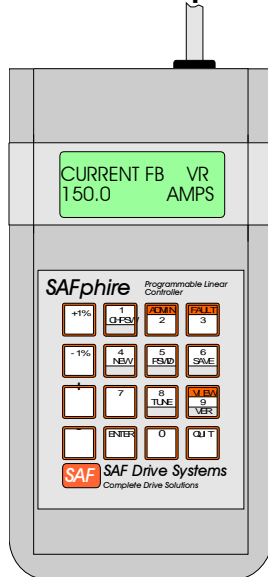


Introduction

HandTerm is an optional tool for OEM SAFphire. It is an RS232 device that is primarily a maintenance or engineering tool and because of the lightness of construction should not be subjected to physical abuse. Variables of all types can be displayed on the LCD display of HandTerm. These variables may be viewable (to look at only), or tunable (to look at and change, if desired) as controlled by the SBL program. The keypad is self-explanatory and with a few minutes of practice, can be quickly mastered. A standard nine pin connector on the cable provides for easy connection or disconnection to OEM SAFphire. The user can plug into a number of OEM SAFphires this way.

All parameters are presented in alpha-numeric form in engineering units to avoid confusing computer codes. SAF Drives Inc. recommends however, that an Industrial Grade Operator Station be used for any permanent plant floor installations.

Display Overview

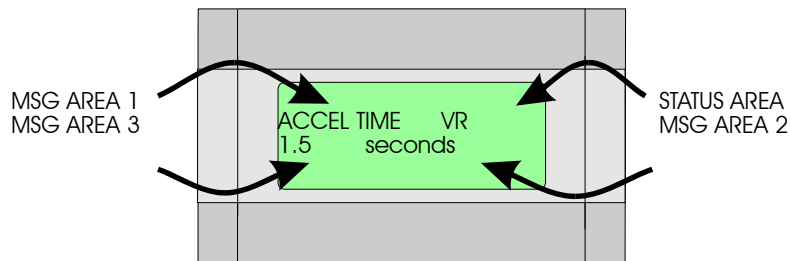


The display is divided into four areas. The top right hand area of the display is the status area. The status area consists of two characters. The first character indicates the mode. The possible modes are:

- C - command mode
- V - view mode (parameter can be viewed only)
- V - view mode (flashing V indicates parameter can be tuned)
- T - tune mode
- A - admin mode
- F - fault mode

The second character is the status character. It is set in the SYS_CONFIG block. It can be used to indicate the status of machines controlled by OEM SAFphire. The possible statuses are:

- R - running
- J - jog
- S - stopped
- E - error
- F - faulted

The message areas are used to display alphanumeric information relating to the current mode or command. An example is in the view mode. A parameter such as current_fb would be shown as follows:

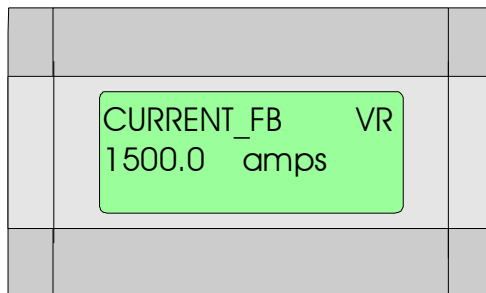

Operating Modes

Command Mode

Command Mode is indicated by a C as the mode character in the status area.

This mode acts as a top-level menu allowing the user to move between the other modes.

The user has the following options:

FAULT (3) - view active faults

ADMIN (2) - enter administration mode

VIEW (9) - enter view mode

View Mode

View Mode is indicated by a V (flashing or solid) as the mode character in the status area.

In this mode the user is able to scroll through the list of the parameters names and their current values. A parameter can be either viewable or tunable. Parameters are stored alphabetically with all viewable parameters before tunable parameters. Tunable parameters are indicated by a flashing V as the mode character. Viewable parameters are indicated by a solid V as the mode character. In the View Mode, the user has the following options.

<+> - display next parameter name and value

<-> - display previous parameter name and value

TUNE (8) - tune the displayed parameter (i.e. enter tune mode) This option is only accessible if the parameter is tunable. This is indicated by a flashing V in the top right hand corner of the screen.

QUIT - quit (return to command mode)

Tune Mode

Tune Mode is indicated by a T as the mode character in the status area.

Tune mode allows the user to modify the value of the selected parameter.

After the parameters have been tuned, they are still only stored in static memory. If the user wishes the changes to be kept they must be saved.

(see Admin Mode)

The user has the following options:

NEW (4) - enter new value for parameter followed by the <ENTER> key

<+1%> - add 1% of the parameter's range to its value

<-1%> - subtract 1% of the parameter's range from its value

<+> - increment the parameter's value

<-> - decrement the parameter's value

<QUIT> - quit (return to view mode)

Admin Mode

Admin Mode is indicated by an A as the mode character in the status area.

The administration menu is used to perform administration type functions.

The user has the following options.

<VER> - Display information relative to software version, program information, parameter status, Node Address etc.

<SAVE> - Save the tuned parameters to battery backed memory so that if power to the rack is interrupted, it will default to the tuned parameters.

<QUIT> - return to command mode

Fault Mode

Fault Mode is indicated by an F as the mode character in the status area.

This mode displays active faults. The active fault is determined by a SYS_CONFIG block and the fault table. The message displayed can be edited using the SBL Development System. Pressing any key will return the user to the command mode.

Technical Support

Contact Us

SAF Drives Inc.

18 Neville St., Unit C
New Hamburg, ON. CAN.
N3A 4G7

Toll Free 1-866 3 ASK SAF (1-866-327-5723), Canada and U.S.

Tel: (519) 662-6489

Fax: (866) 280-5247

email: answers@safdrives.com